




# BLAIR HILL WIND FARM

## Figure 10.9

### PRIVATE WATER SUPPLY RISK ASSESSMENT

Reproduced from Ordnance Survey digital data © Crown copyright and database rights 2024. All rights reserved. License number 0100031673.

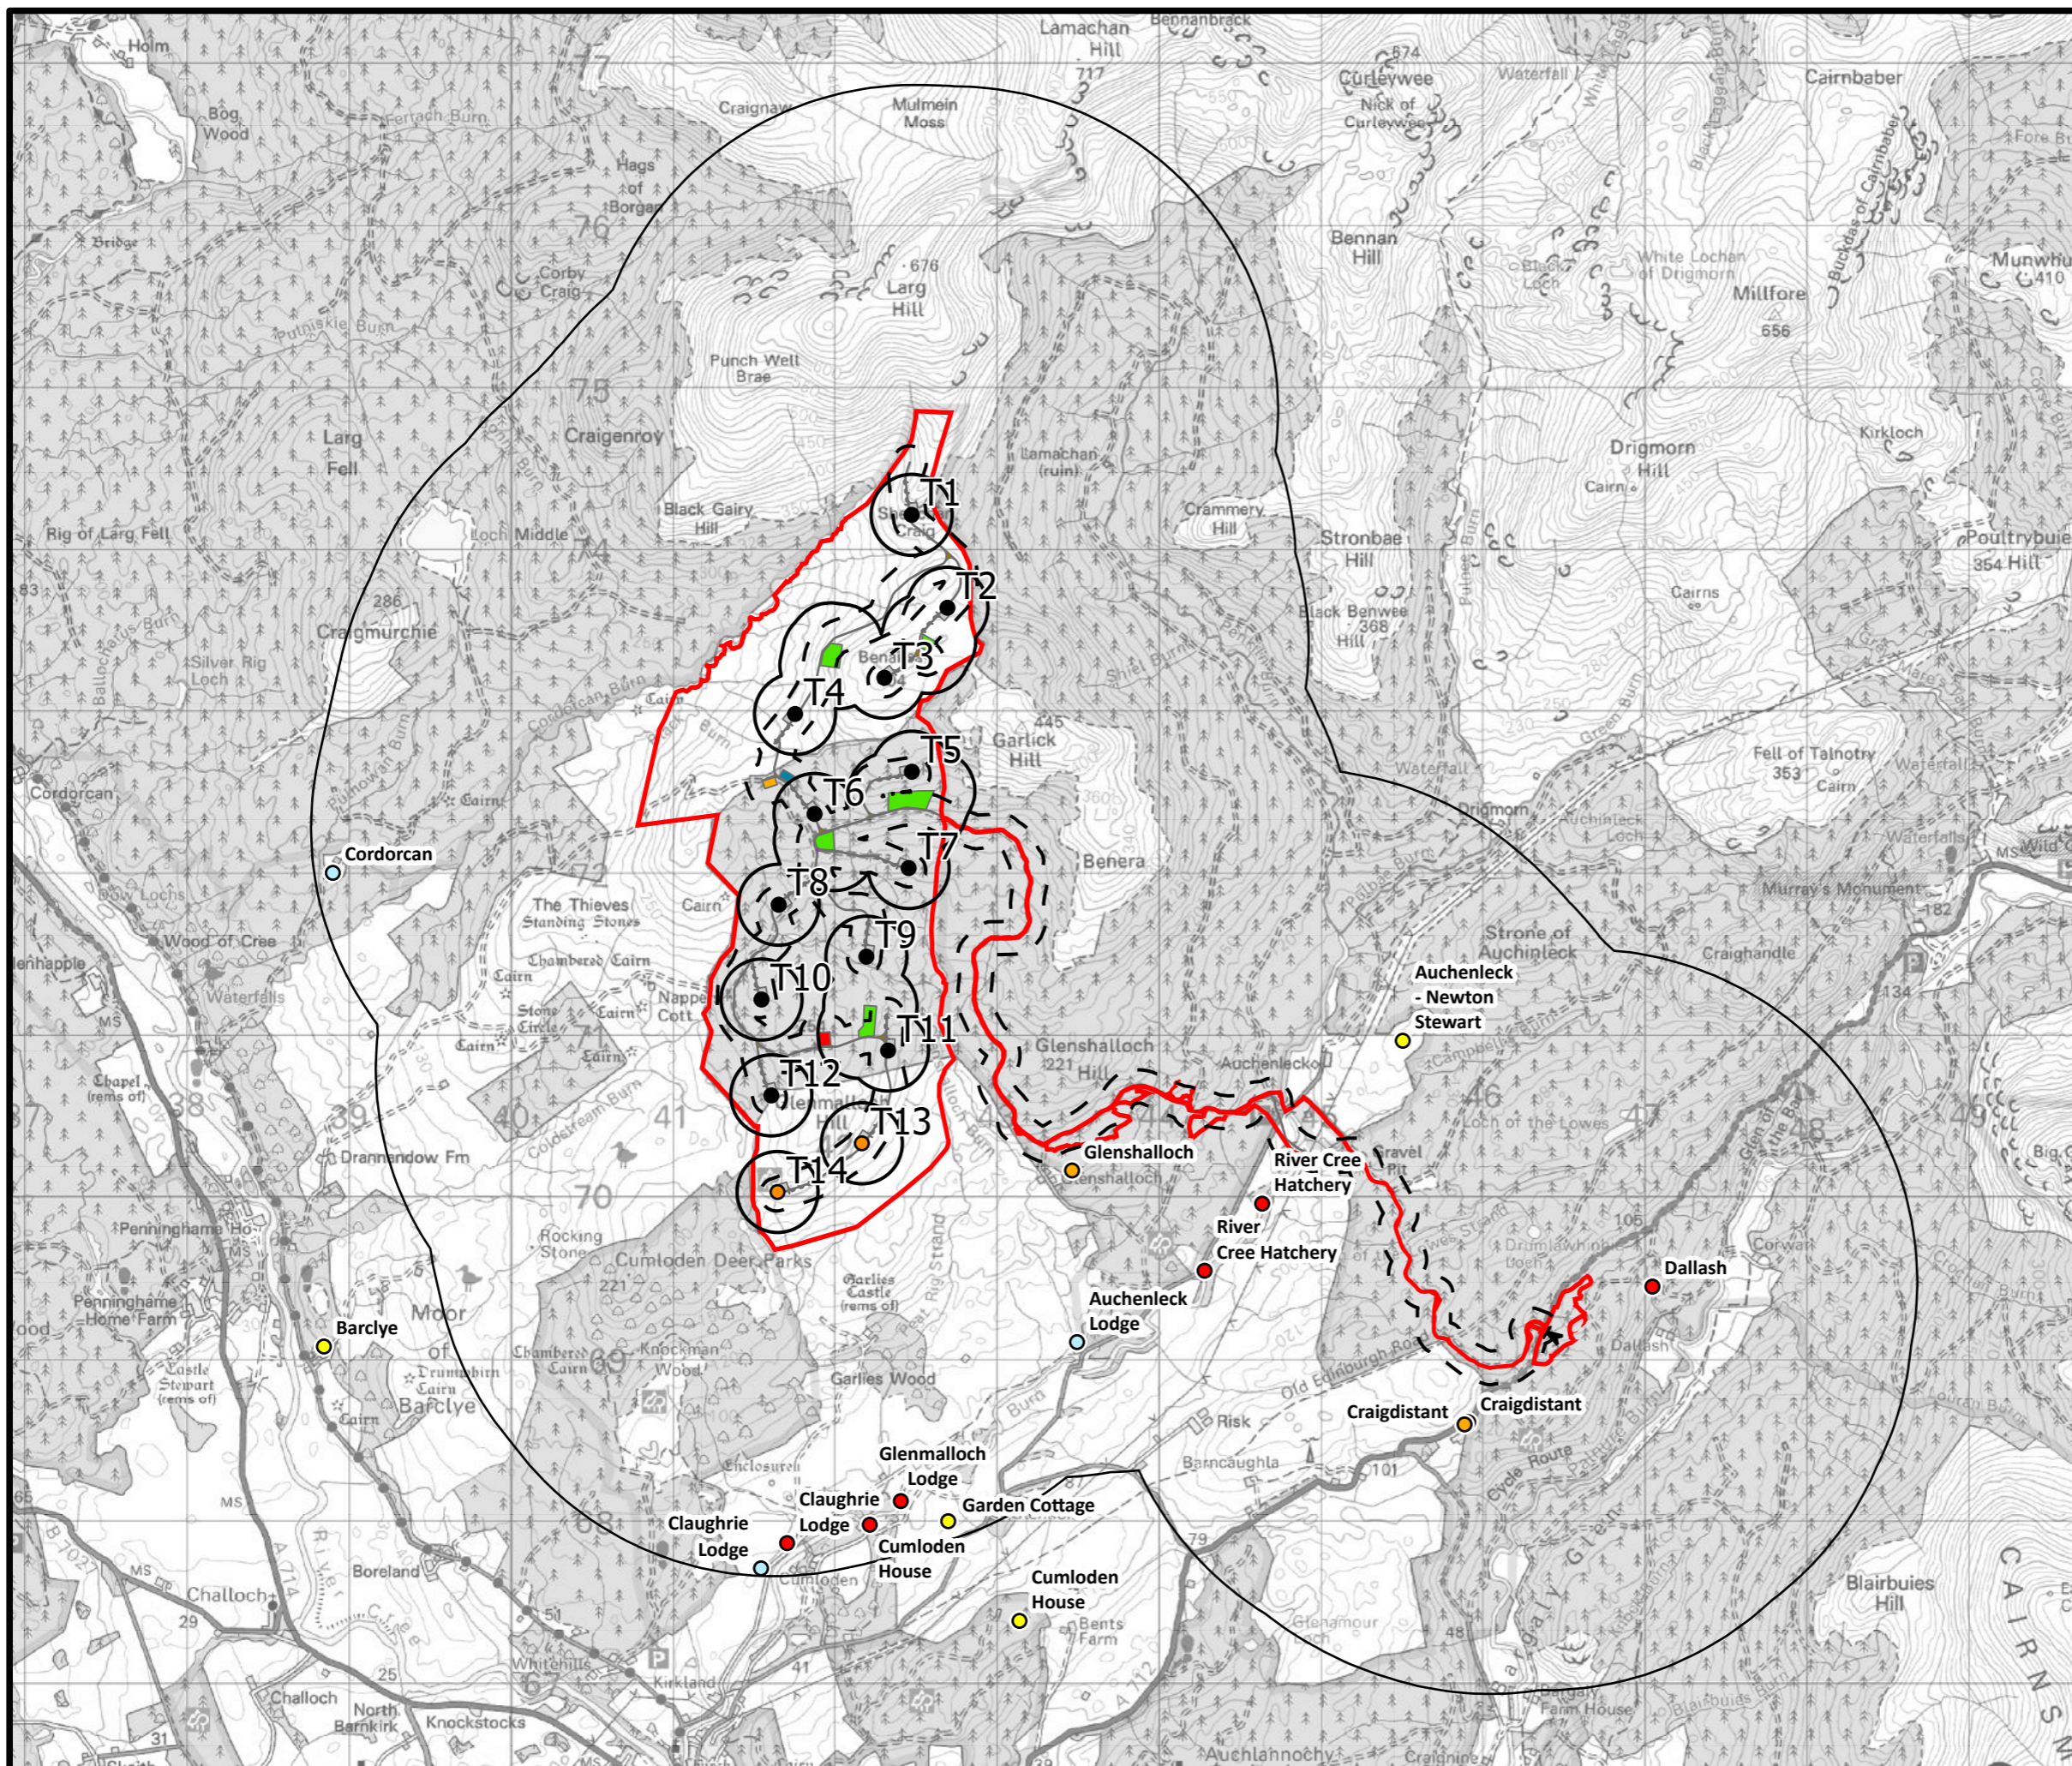

- Site Boundary
- Site Entrance
- PWS Study Area (2 km)
- Infrastructure Buffer (100 m)
- Infrastructure Buffer (250 m)

#### Indicative Turbine Locations

- 210 m Tip Height
- 250 m Tip Height
- Temporary Hardstandings
- Permanent Hardstandings
- Watercourse Crossing
- New Site Tracks
- Upgraded Tracks
- Control Building and Substation
- Borrow Pit Search Areas
- Temp Construction Compound
- Temp Batching Plant

#### Source Locations

- Borehole
- Spring
- Stream Abstraction
- Well



SCALE - 1:40,000 @ A3

#### ENVIRONMENTAL IMPACT ASSESSMENT REPORT 2024

THIS DRAWING IS THE PROPERTY OF RENEWABLE ENERGY SYSTEMS LTD. AND NO REPRODUCTION MAY BE MADE IN WHOLE OR IN PART WITHOUT PERMISSION