




BLAIR HILL WINDFARM PRIVATE WATER SUPPLY RISK ASSESSMENT

Drawing 2

SURFACE HYDROLOGY

Reproduced from Ordnance Survey digital data © Crown copyright and database rights 2024. All rights reserved. License number 0100031673.

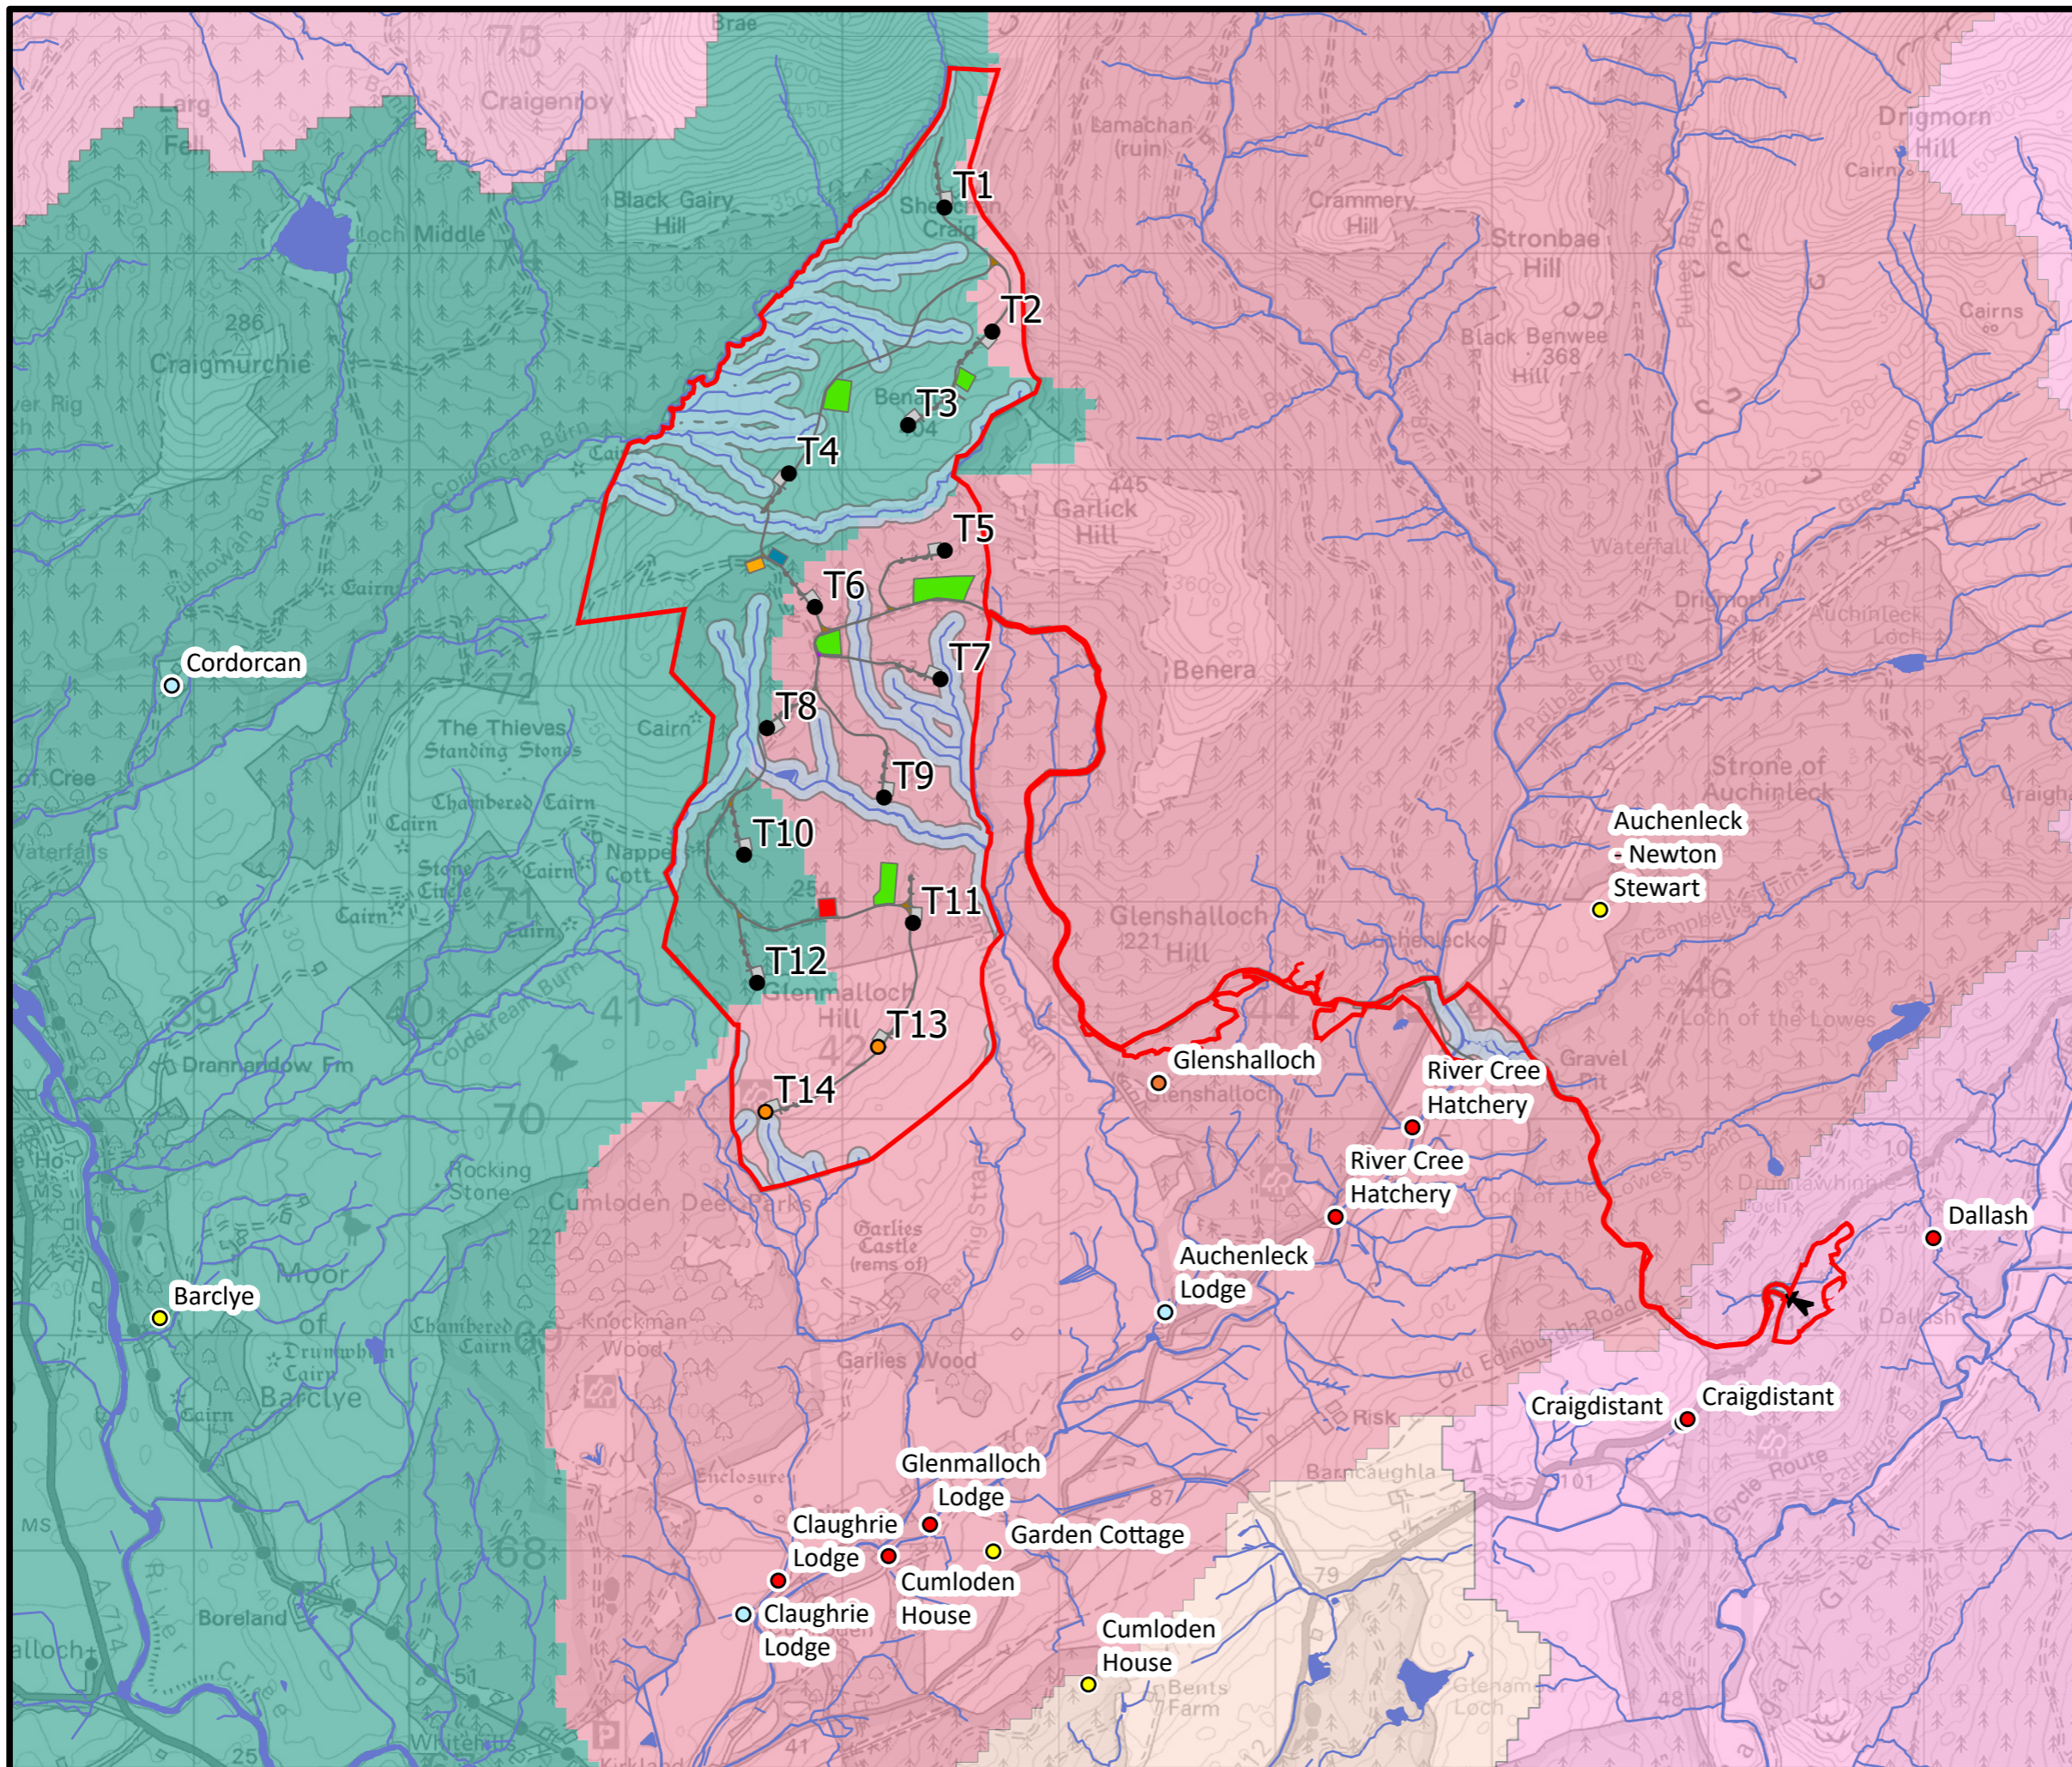

- Site Boundary
- Site Entrance
- Indicative Turbine Locations
 - 210 m Tip Height
 - 250 m Tip Height
- Temporary Hardstandings
- Permanent Hardstandings
- Watercourse Crossing
- New Site Tracks
- Upgraded Tracks
- Control Building and Substation
- Borrow Pit Search Areas
- Temp Construction Compound
- Temp Batching Plant
- Watercourses
- Waterbodies
- Watercourse Buffer (50 m)
- Source Locations
 - Borehole
 - Spring
 - Stream Abstraction
 - Well
- SEPA Catchments
 - Galloway Coastal between River Cree and Palnure Burn
 - Palnure Burn @ mouth
 - Penkiln Burn @ confluence with River Cree
 - River Cree @ confluence with Penkiln Burn
 - River Dee @ confluence with Cooran Lane
 - Water of Minnoch @ confluence with River Cree



SCALE - 1:30,000 @ A3

ENVIRONMENTAL IMPACT ASSESSMENT REPORT 2024

THIS DRAWING IS THE PROPERTY OF RENEWABLE ENERGY SYSTEMS LTD. AND NO REPRODUCTION MAY BE MADE IN WHOLE OR IN PART WITHOUT PERMISSION